




BXChps

BXChps1842/1876 / BXC2 1898/1899


In event of an interruption of the supply of power or manually switching off the fan -
Note that the extract unit with indicator needs to be manually reset. See below for details.



Resetting

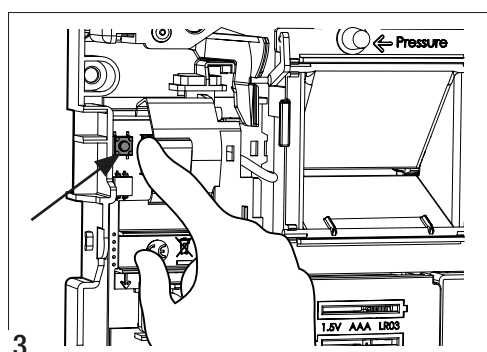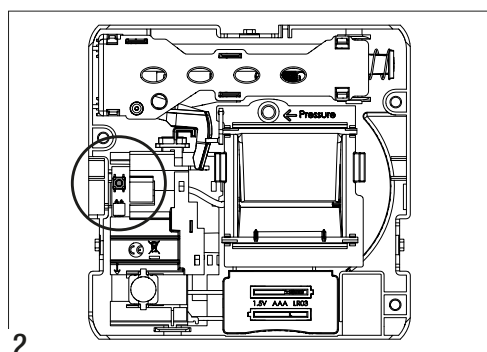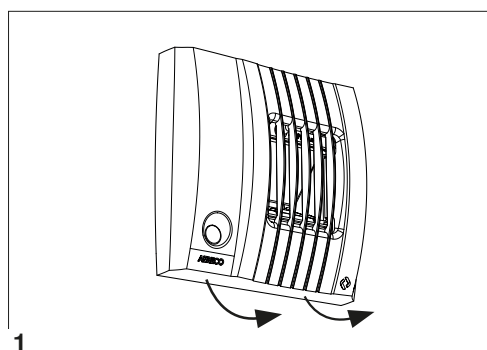

Setting status

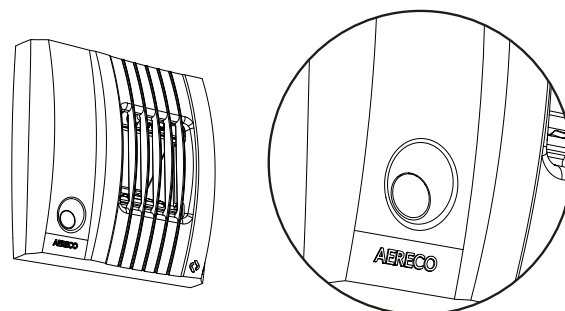

• Setting status:

Ventilation system OK:

3 beeps + green LED

Ventilation system faulty:

3 beeps + red LED

Pressure sensor failure:

long beep + blue LED

Power fault:

no light